



CIVIL GEOTECHNICAL SERVICES
ABN 26 474 013 724
PO Box 678 Croydon Vic 3136
Telephone: 9723 0744 Facsimile: 9723 0799

26th September 2024

Our Reference: 24310:NB1983

Winslow Constructors Pty Ltd
50 Barry Road
CAMPBELLFIELD VIC 3061

Dear Sirs/Madams,

**RE: LEVEL 1 EARTHWORKS INSPECTION AND TESTING
OFFICER CENTRAL – STAGE 9 (OFFICER)**

Please find attached our Report No's 24310/R001 to 24310/R002, and Chadwick Geotechnics Report No HDR:W24DS01486 which relate to the field density testing that was conducted within the filled allotments at the above subdivision. The level 1 inspections and associated field density testing commenced in May 2024 and was completed in September 2024.

The inspections and testing of the earthworks was undertaken in general accordance with the Level 1 requirements of AS 3798 - Guidelines on Earthworks for Commercial and Residential Developments.

The site inspections and supervision were performed by experienced geotechnicians from this office. Any areas that were deemed unsatisfactory were reworked and retested under their supervision. The testing was performed to the relevant Australian Standards and the accompanying test reports carry NATA endorsement. The attached compaction results, which were located randomly throughout the fill profile, are considered to be representative of the bulk fill materials that were placed across the reported allotments by Winslow Constructors during the aforementioned period. The approximate locations of the field density tests can be seen on the attached plan (Figure 1).


We are of the view that the bulk fill materials that have been placed across the reported allotments by Winslow Constructors during the aforementioned period can be considered as having been placed in a controlled manner to a minimum density ratio of 95% (standard compactive effort).

Please contact the undersigned if you require any additional information.

Civil Geotechnical Services

Nick Brock

FIGURE 1

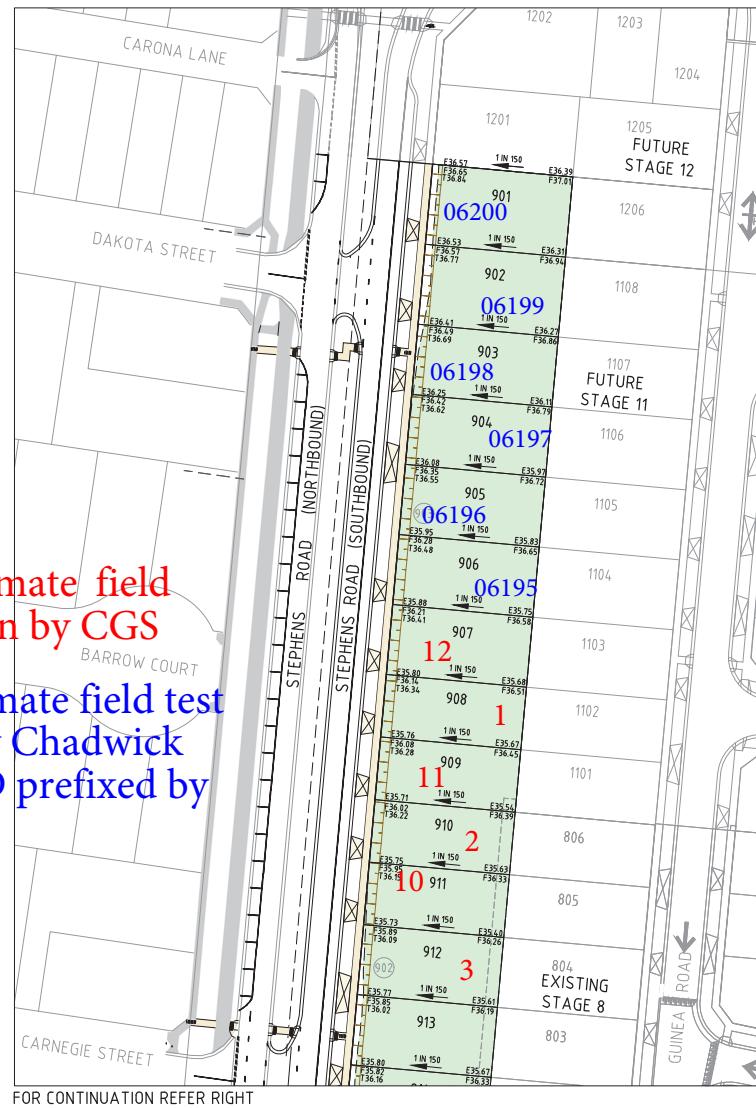


Approximate field test location by CGS

Approximate field test location by Chadwick
(Sample ID prefixed by S24DS-)

FOR CONTINUATION REFER RIGHT

 FILL GREATER THAN 200mm
 CUT GREATER THAN 200mm

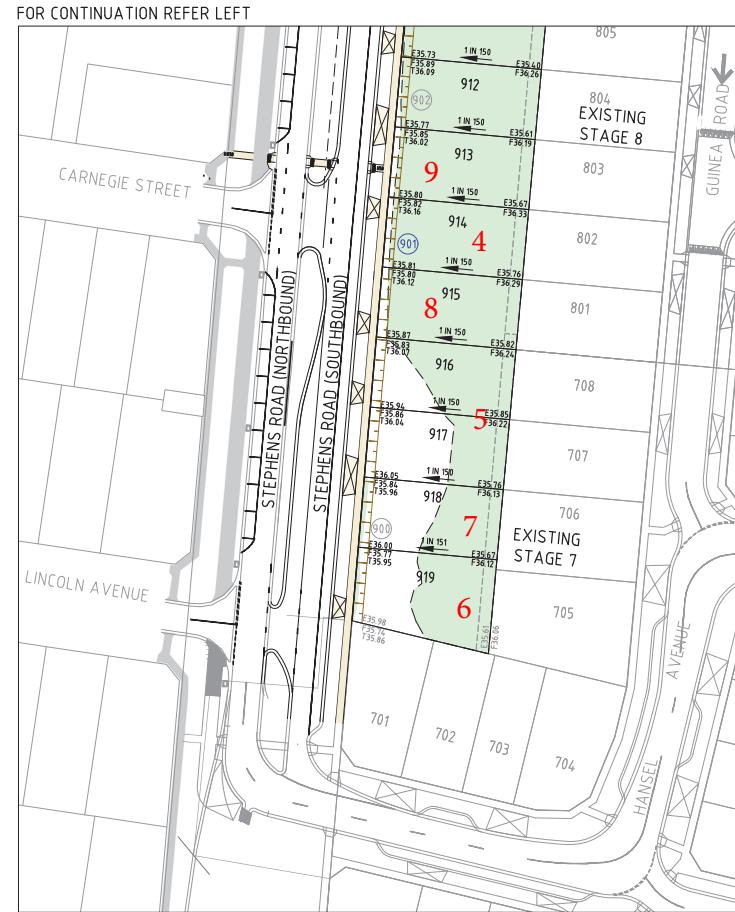

WARNING
BEWARE OF UNDERGROUND/OVERHEAD SERVICES
THE LOCATION OF SERVICES ARE APPROXIMATE ONLY, AND THEIR
EXACT POSITION SHOULD BE PROVEN ON SITE. NO GUARANTEE IS
GIVEN THAT ALL EXISTING SERVICES ARE SHOWN. SPECIAL
CONSIDERATION SHOULD BE GIVEN TO CONSTRUCTION PROCEDURES
UNDER OVERHEAD ELECTRICITY TRANSMISSION LINES.

**OFFICER CENTRAL
STAGE 9
ROAD AND DRAINAGE
ROAD LAYOUT PLANS - EARTHWORKS PLAN
CARDINIA SHIRE
YOURLAND PTY LTD**

PRELIMINARY **Drg No** **310308CR20**



YourLand
Developments

signed	Checked
R.MATHEW	B.IBBS
authorised	Date
WAREHAM	DEC 2023

File name 310308CR200.dwg layout name CR202 plotted by Benjamin Schultze

COMPACTION ASSESSMENT

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Job No 24310
 Report No 24310/R001
 Date Issued 07/06/24

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	CV
Project	OFFICER CENTRAL - STAGE 9	Date tested	05/06/24
Location	OFFICER	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 13:56
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	1	2	3	4	5	6
Location	REFER TO FIGURE 1					
Approximate depth below FSL						
Measurement depth mm	175	175	175	175	175	175
Field wet density t/m³	1.99	2.09	2.02	2.11	2.04	2.03
Field moisture content %	18.3	19.1	17.6	19.3	17.8	19.0

Test procedure AS 1289.5.7.1

Test No	1	2	3	4	5	6
Compactive effort	Standard					
Oversize rock retained on sieve mm	19.0	19.0	19.0	19.0	19.0	19.0
Percent of oversize material wet	0	0	0	0	0	0
Peak Converted Wet Density t/m³	2.09	2.11	2.05	2.17	2.07	2.10
Adjusted Peak Converted Wet Density t/m³	-	-	-	-	-	-
Optimum Moisture Content %	20.5	21.0	19.5	22.0	17.5	21.0

Moisture Variation From Optimum Moisture Content	2.0% dry	2.0% dry	2.0% dry	2.5% dry	0.0% dry	2.0% dry
--	----------	----------	----------	----------	----------	----------

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD}) %	95.0	99.0	98.5	97.0	99.0	96.5
------------------------------------	------	------	------	------	------	------


Material description

No 1 - 6 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing



Approved Signatory : Justin Fry

COMPACTION ASSESSMENT

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Job No 24310
Report No 24310/R002
Date Issued 20/07/24

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	CV
Project	OFFICER CENTRAL - STAGE 9	Date tested	07/06/24
Location	OFFICER	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 12:12
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	7	8	9	10	11	12
Location	REFER TO FIGURE 1					
Approximate depth below FSL						
Measurement depth mm	175	175	175	175	175	175
Field wet density t/m³	1.99	1.96	2.12	1.96	2.01	2.06
Field moisture content %	16.2	15.3	15.7	17.5	15.8	15.5

Test procedure AS 1289.5.7.1

Test No	7	8	9	10	11	12
Compactive effort	Standard					
Oversize rock retained on sieve mm	19.0	19.0	19.0	19.0	19.0	19.0
Percent of oversize material wet	0	0	0	0	0	0
Peak Converted Wet Density t/m³	2.02	2.06	2.16	2.04	2.05	2.10
Adjusted Peak Converted Wet Density t/m³	-	-	-	-	-	-
Optimum Moisture Content %	16.5	16.0	18.0	20.5	16.0	17.0

Moisture Variation From Optimum Moisture Content	0.5% dry	0.5% dry	2.5% dry	2.5% dry	0.0% dry	1.5% dry
--	----------	----------	----------	----------	----------	----------

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD}) %	98.5	95.5	98.0	96.0	98.0	98.0
------------------------------------	------	------	------	------	------	------


Material description

No 7 - 12 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
Accredited for compliance with
ISO/IEC 17025 - Testing



Approved Signatory : Justin Fry

HILF Density Ratio Report

Client: Winslow Constructors Pty Ltd
Address: 50 Barry Road
 Campbellfield vic 3061
Project: WIN - Officer Central, Stage 9
Project No.: 1096484.06-STG9

Order No.: CG Request No.:
TRN: Lot No.:



Sample Details

Location: Corner of Stephens Road & Rix Road, Officer
Client Request ID:
Specification Requirements: Minimum Hilf Density Ratio of 95%
Field Test procedures: AS 1289.5.8.1
Laboratory Test procedures: AS 1289.2.1.1, AS 1289.5.7.1
Sampling Method: AS1289.1.2.1 Clause 6.4 (b)
Source: In-Situ
Material: Clay

Sample Data

Sample ID	S24DS-06195	S24DS-06196	S24DS-06197	S24DS-06198	S24DS-06199	S24DS-06200
Field Sample ID	1	2	3	4	5	6
Date Tested	3/09/2024	3/09/2024	3/09/2024	3/09/2024	3/09/2024	3/09/2024
Time Tested	10:10	10:19	10:28	10:39	10:45	10:58
Lot:	906	905	904	903	902	901
Layer:	FSL	FSL	FSL	FSL	FSL	FSL

Field and Laboratory Data

Depth of Test (mm)	175	175	175	175	175	175
Depth of Layer (mm)	200	200	200	200	200	200
AS Sieve Size (mm)	19.0	19.0	19.0	19.0	19.0	19.0
Oversize Wet (%)	0	0	0	0	0	0
Field Moisture Content (%)	10.5	9.2	11.6	12.4	11.5	11.4
Field Moisture Content Method	AS 1289.2.1.1					
Field Wet Density (t/m³)	2.16	2.13	2.13	2.14	2.15	2.04
Field Dry Density (t/m³)	1.96	1.95	1.91	1.90	1.93	1.83
Peak Converted Wet Density (t/m³)	2.06	2.15	2.07	2.07	2.08	1.91
Optimum Moisture Content (%)	10.0	11.5	11.0	14.5	14.0	11.5
Compactive Effort	Standard	Standard	Standard	Standard	Standard	Standard
Moisture Ratio (%)	102.5	79.5	103.5	84.5	82.5	100.0
Moisture Variation (%)	0.5 wet	2.5 dry	0.5 wet	2.0 dry	2.5 dry	0.0
Hilf Density Ratio (%)	105.0	98.5	102.5	103.0	103.5	107.0

Comments